




# SDD 09H05 Cabinet Breaker Disconnect Box Installation

## GENERAL NOTES

MINIMUM REQUIREMENT SHOWN. ADDITIONAL BREAKERS MAY BE REQUIRED.

UP TO THREE BREAKERS WILL BE CONSIDERED INCIDENTAL TO THE ITEM BREAKER DISCONNECT BOX.

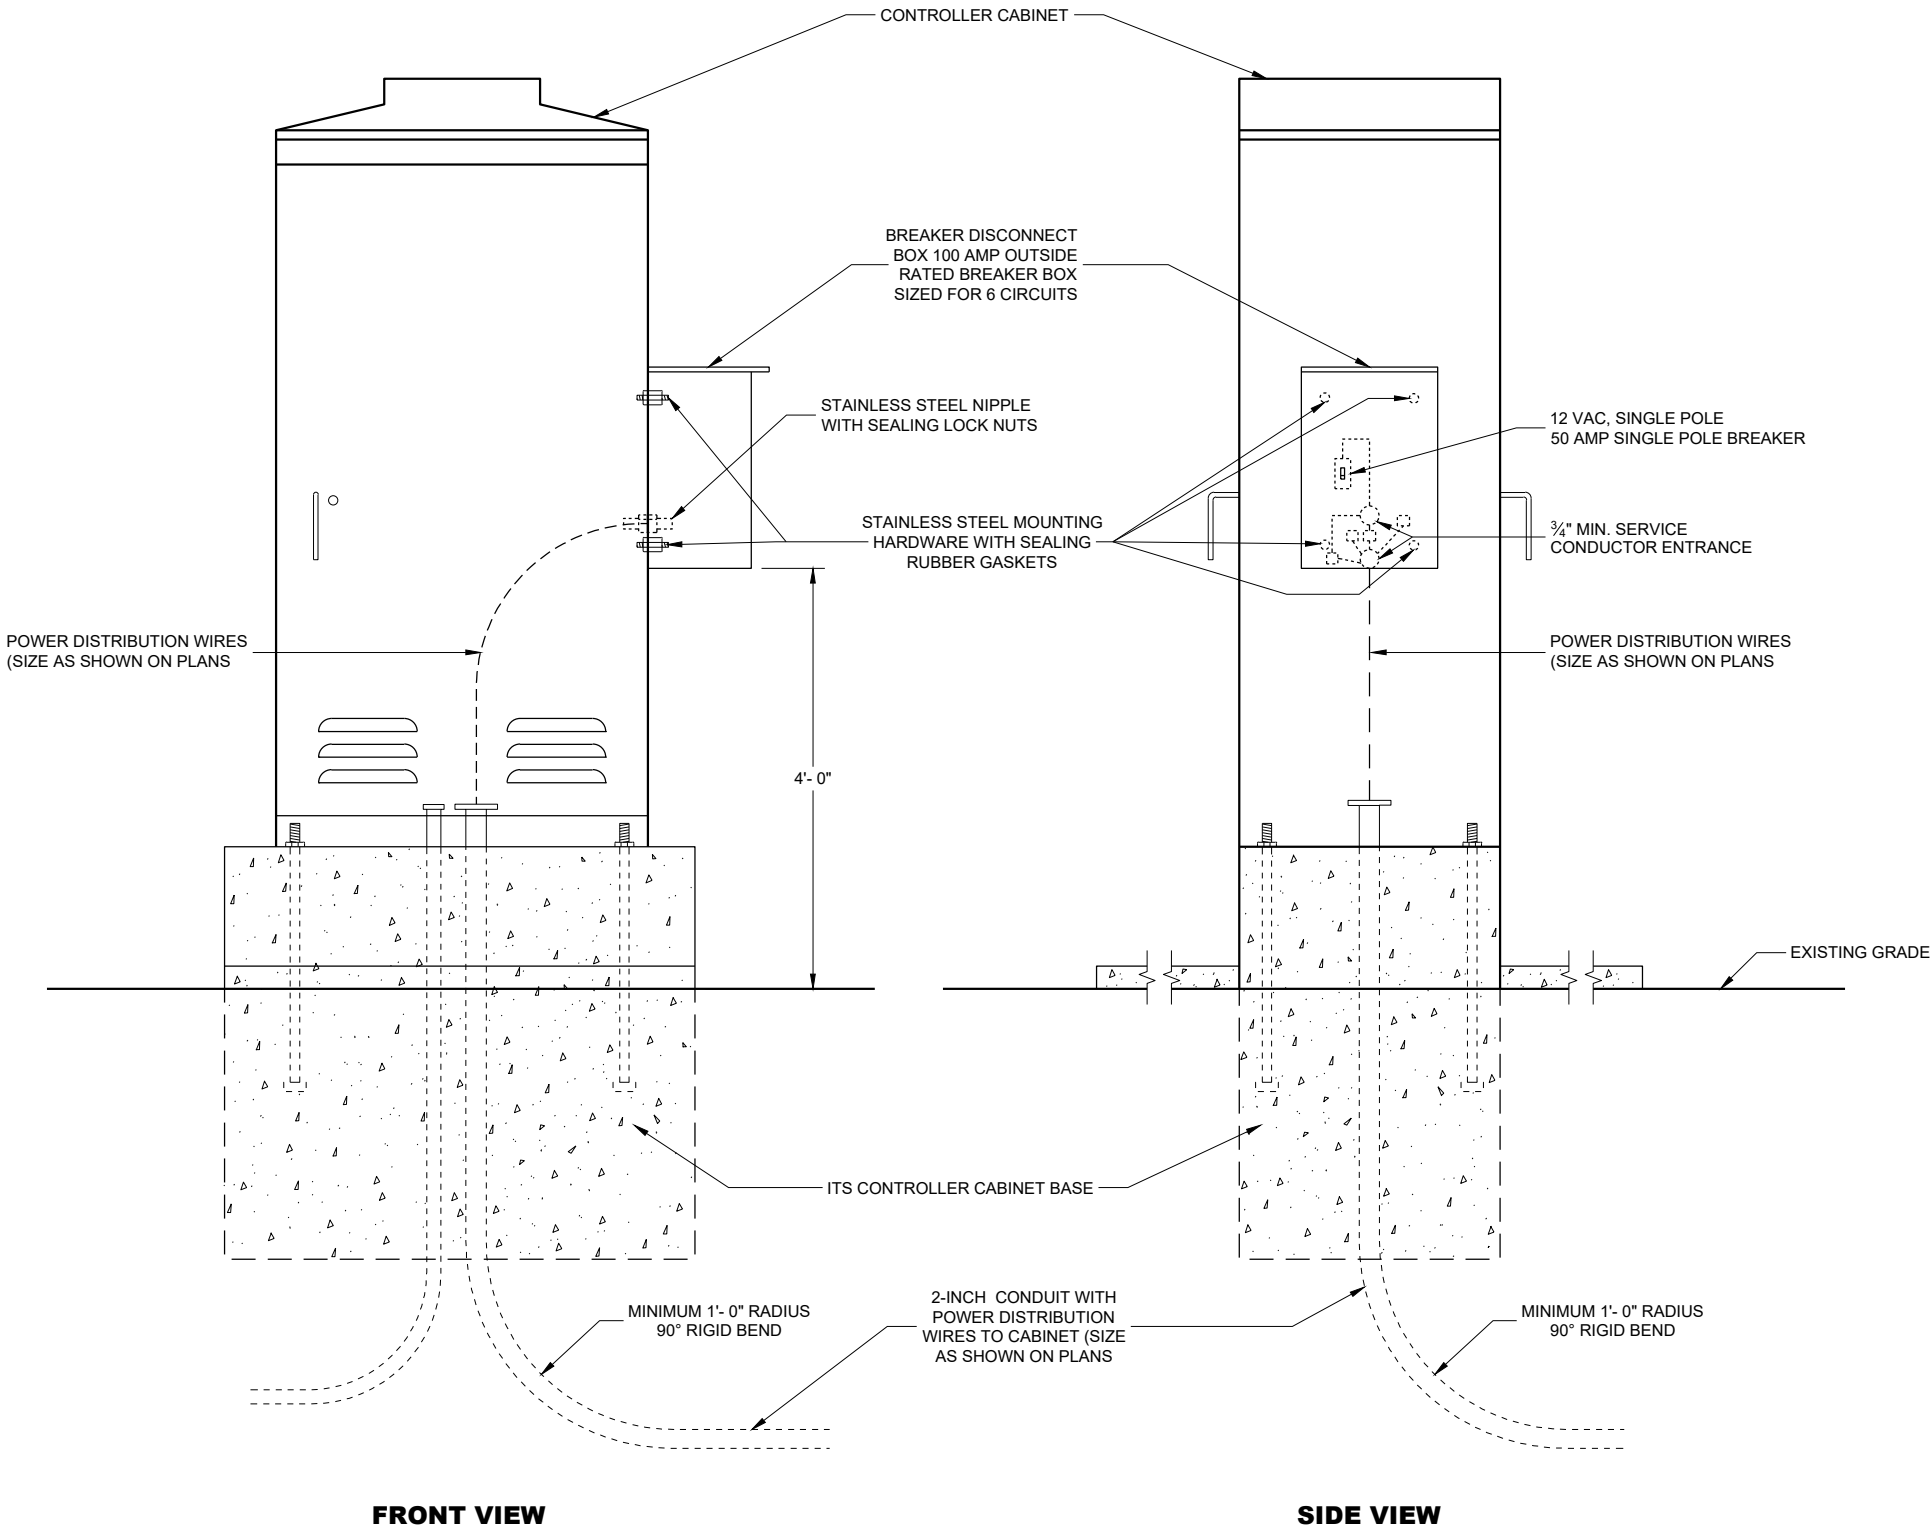

CIRCUIT BREAKER DISCONNECT BOX INSTALLATION

## CABLE BREAKER DISCONNECT BOX INSTALLATION

STATE OF WISCONSIN  
DEPARTMENT OF TRANSPORTATION

APPROVED  
September 2014 /S/ Ahmet Demirbilek  
DATE STATE ELECTRICAL ENGINEER

FHWA

*Cabinet Breaker Disconnect Box Installation***References:**

[FDM15-5 Attachment 30.5](#) and [30.6](#) for conventional symbols

[Standard Spec. 656](#) Electrical Service

[Standard Spec. 670](#) General Requirements for Intelligent Transportation Systems

**Bid items associated with this drawing:**

<u>ITEM NUMBER</u>	<u>DESCRIPTION</u>	<u>UNIT</u>
656.0201	Electrical Service Meter Breaker Pedestal (location).....	EACH

**Standardized Special Provisions associated with this drawing:**

<u>STSP NUMBER</u>	<u>TITLE</u>
NONE	

**Other SDDs associated with this drawing:**

<a href="#">SDD 9B2</a>	Conduit
<a href="#">SDD 9H1</a>	Base ITS Controller Cabinet
NONE	

**Design Notes:**

NONE

**Contact Person:**

Ahmet Demirbilek (414) 220-6801  
(414) 322-9606 (Mobile)